


Harmonized Wire Coding System

This chart illustrates the harmonization code for cable "H05VVVF3G0.75"

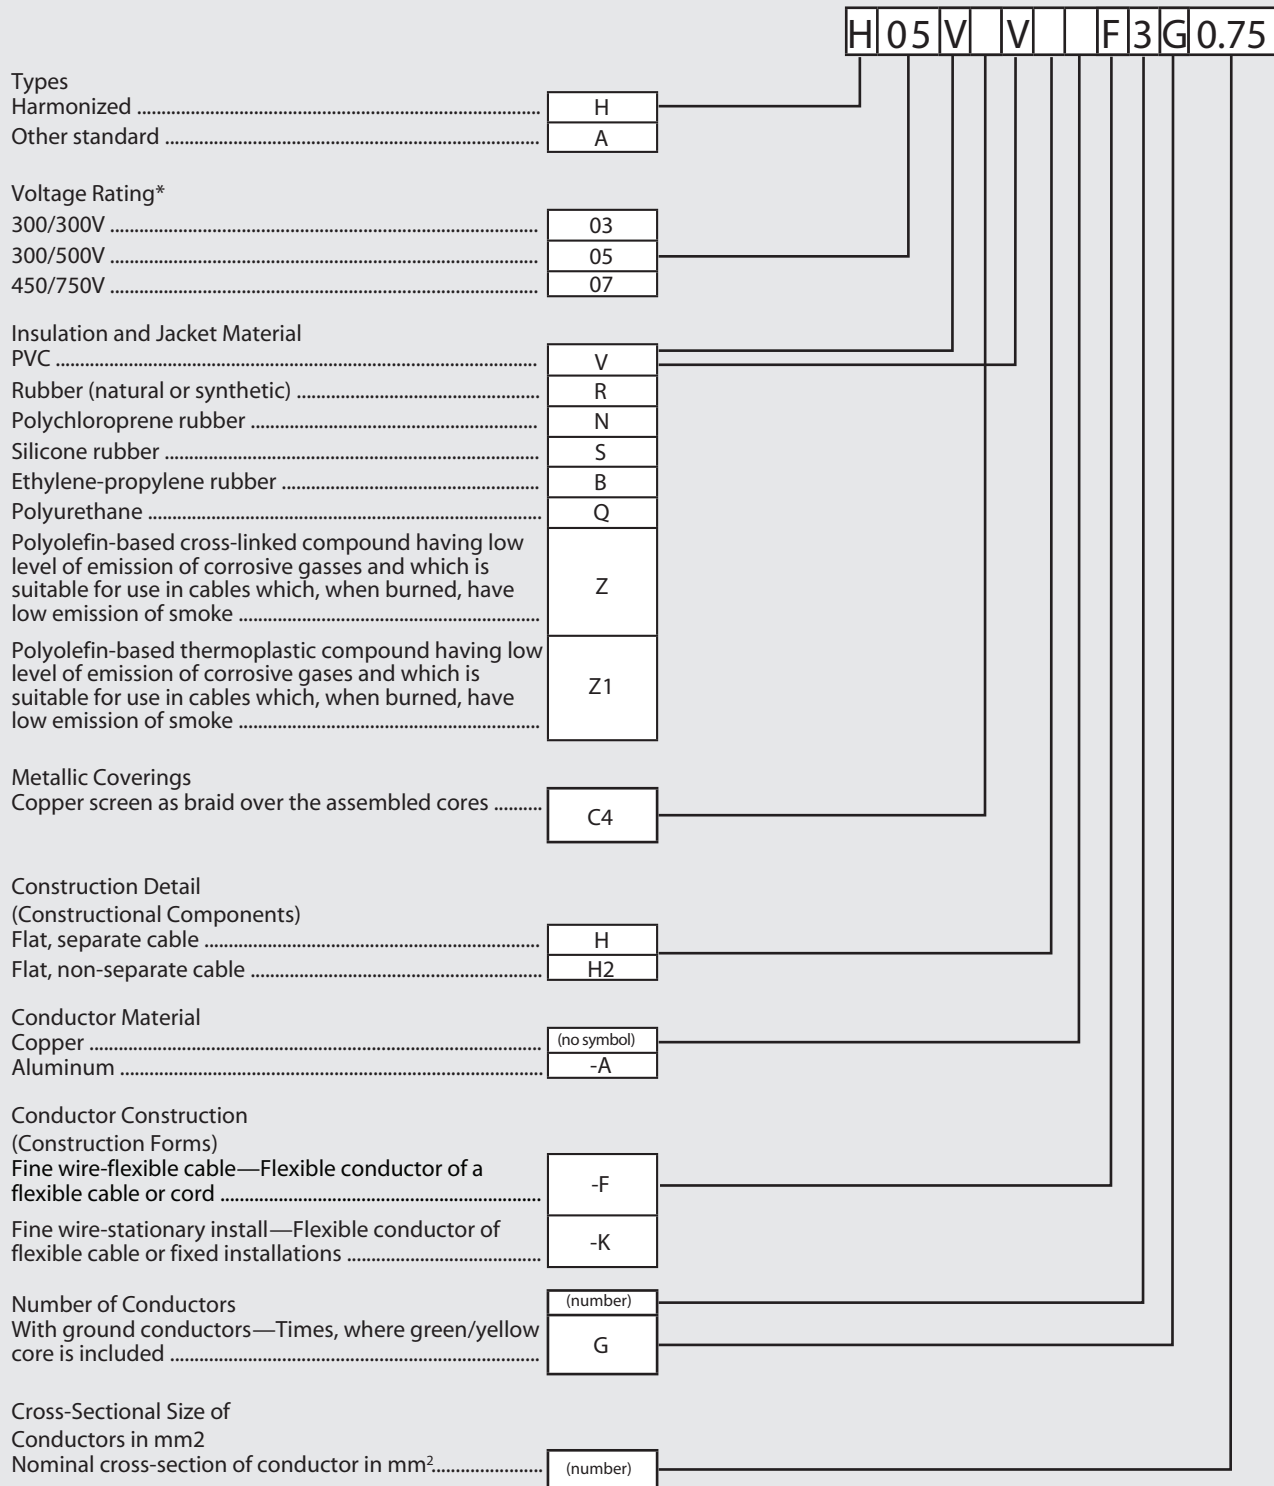

Source for Harmonized Wire Coding System: HD 361 53

*The rated voltage in an alternating current system, is expressed by the combination of two values U_0/U , expressed in volts, where:

a) " U_0 " is the r.m.s value between any insulated conductor and "earth" (metal covering of the cable or the surrounding medium);

b) " U " is the r.m.s. value between any two phase conductors of a multicore cable or of a system of a single core cables.

In an alternating current system, the rated voltage of a cable should be at least equal to the nominal voltage of the system for which it is intended. This condition applies to the values of both U_0 and U .

Source: EN 50525-1 Section 4